


CR-* Type Cable Glands featuring CROCLOCK® – ASSEMBLY INSTRUCTIONS**

Brief Description

The Peppers CR-*** type cable gland featuring CROCLOCK® universal armour clamping is for outdoor use in the appropriate Hazardous Areas with circular armoured, unarmoured, braided and screened cable. It provides a displacement seal on the inner sheath and gives environmental protection to IP66/67/68 (50 metres for 7 days) and Deluge. A variant giving electrical continuity to a lead sheath is available. A termination suitable for EMC protection can be made using armoured cables with this gland.

Warning

Please read these instructions carefully. These products should not be used in applications except as detailed here or in our datasheets, unless confirmed in writing by Peppers. Peppers take no responsibility for any damage, injury or other consequential loss caused where products are not installed or used according to these instructions. This leaflet is not intended to advise on the selection of product. Further guidance can be found in the standards listed overleaf or the prevailing code of practice.

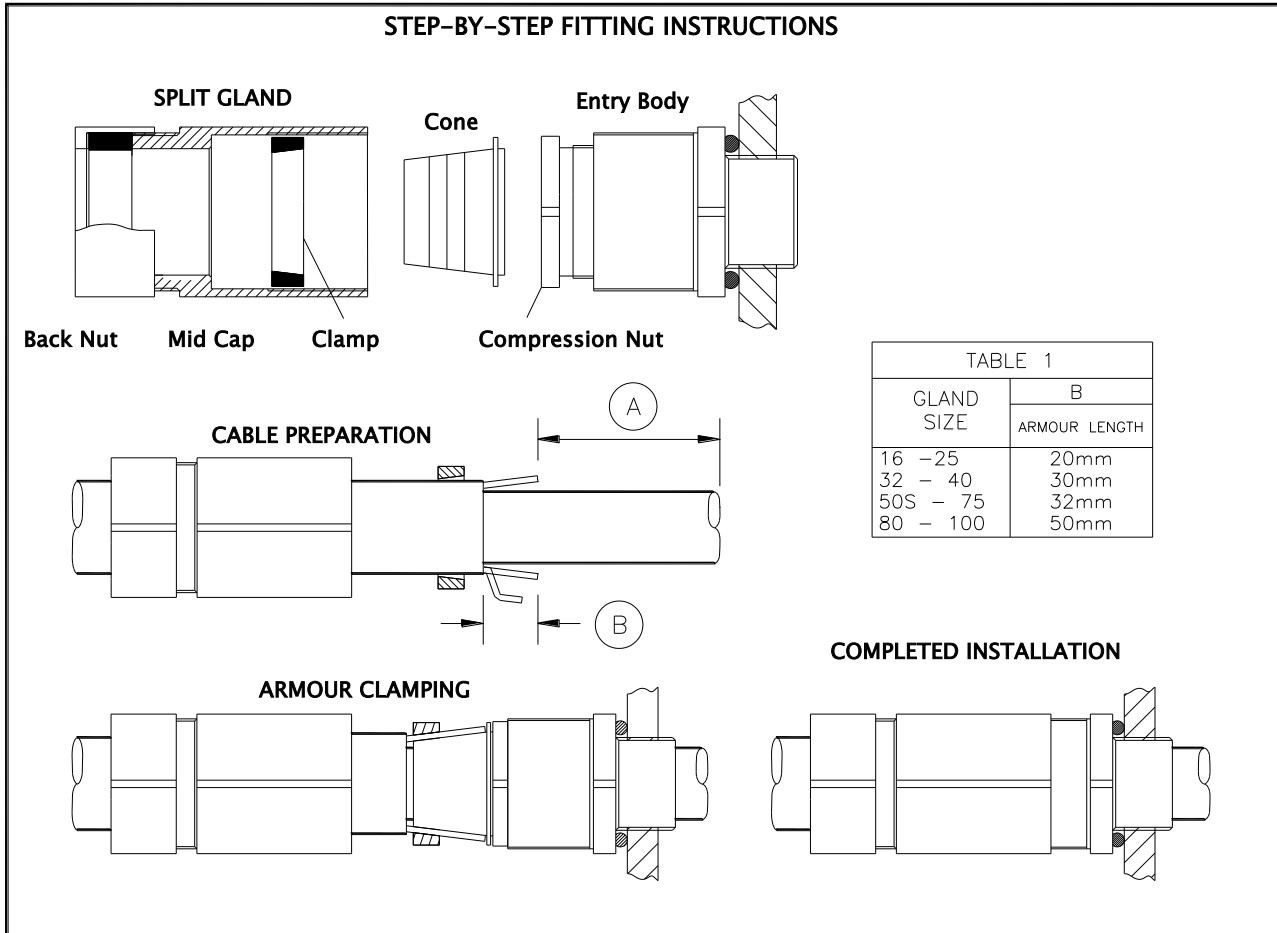

STEP-BY-STEP FITTING INSTRUCTIONS

- 1 Split gland as shown
- 2 Fit Entry Body, allowing for any installation accessories, and fully engage the thread into the equipment. Hand-tighten, then suitably secure with a wrench.
- 3 Slide Rear Assembly (and shroud if required) onto cable as shown.
- 4 **Prepare Cable**
A Strip outer jacket and armour length to suit installation. On CR-2**/CR-4** options (lead sheathed cable) the lead sheath must pass through the Continuity Washer when installation is complete (the Continuity Washer is fitted under the Compression Nut)
B Expose armour. For approximate lengths see Table 1 column B. Where sheath sizes are near minimum, form armour to facilitate clamping as shown.
- 5 Slide the Clamp over the exposed armour. Ensure the Clamp is in the correct orientation.
- 6 Slide Cone onto inner sheath and under armour. Slide Clamp onto exposed armour
- 7 **For lead sheathed cable** - Unscrew the Compression Nut, remove the Continuity Washer and replace the Nut.
For all cables Insert cable through Entry Body. Push cable forward to maintain armour contact.
- 8 To clamp armour/braid onto Cone, hand-tighten Mid Cap to Entry Body. For cable with maximum diameter wire armour it may be necessary to remove the internal skid washer (located under nut) first. Support the cable to prevent it from twisting then, using wrench, tighten a further 1 turn. Cable with maximum diameter wire armour may require an additional ½ to 1 turn.
- 9 Loosen off Mid Cap to visually check armour is securely locked. If armour has not clamped repeat the clamping process.
For lead sheathed cable - Replace Continuity Washer and Nut. Reinsert cable.
For all cables (If removed replace internal skid washer) Tighten Compression Nut so that seal makes full contact with cable sheath and then tighten the Compression Nut by the additional turns detailed in Table 2.
- 10 Re-tighten Mid Cap by hand until tight. For cable with wire armour turn Mid Cap a further 1 turn with a wrench. For cable with all other armour types turn Mid Cap a further ¼ turn with a wrench after hand tight.
- 11 Hold Mid Cap with wrench and tighten the Back Nut onto cable. Ensure the seal makes full contact with cable outer sheath and then tighten the back nut by the additional turns detailed in Table 2. If fitted, pull shroud over gland assembly.

CR-*** Cable Glands featuring CROCLOCK® - ASSEMBLY INSTRUCTIONS

Table 2 - Installation Data, Cable Sizes and Armour Acceptance (mm)

Gland Size	Compression Nut Turns – Step 9	Back Nut Turns – Step 11	Inner Sheath		Outer Sheath		Reduced Bore		Armour Acceptance Ranges	
			Min	Max	Min	Max	Min	Max	Min	Max
16	1	1	3.4	8.4	8.4	13.5	6.7	10.3	0.1	1.25
20S	1	1	7.2	11.7	11.5	16.0	9.4	12.5	0.1	1.25
20	1	1	9.4	14.0	15.5	21.1	12.0	17.6	0.1	1.25
25	1	1	13.5	20.0	20.3	27.4	16.8	23.9	0.1	1.6
32	1	2	19.5	26.3	26.7	34.0	23.2	30.5	0.1	2.0
40	1	1	23.0	32.2	33.0	40.6	28.6	36.2	0.1	2.0
50S	1	1	28.1	38.2	39.4	46.7	34.8	42.4	0.1	2.5
50H	1	2	28.1	38.2	45.7	53.2	41.1	48.5	0.1	2.5
50	1	2	33.1	44.1	45.7	53.2	41.1	48.5	0.1	2.5
63S	1	1	39.2	50.1	52.1	59.5	47.5	54.8	0.1	2.5
63H	1	1	39.2	50.1	58.4	65.8	53.8	61.2	0.1	2.5
63	1	1	46.7	56.0	58.4	65.8	53.8	61.2	0.1	2.5
75S	1 ¼	1	52.1	62.0	64.8	72.2	60.2	68.0	0.1	2.5
75H	1 ¼	1	52.1	62.0	71.1	78.0	66.5	73.4	0.1	2.5
75	1 ¼	1	58.0	68.0	71.1	78.0	66.5	73.4	0.1	2.5
80	1 ¼	1	62.2	72.0	77.0	84.0	71.9	79.4	0.1	3.15
80H	1 ¼	1	62.2	72.0	79.6	90.0	75.0	85.4	0.1	3.15
85	1 ¼	1	69.0	78.0	79.6	90.0	75.0	85.4	0.1	3.15
90	1	3	74.0	84.0	88.0	96.0	82.0	91.4	0.1	3.15
90H	1	1	74.0	84.0	92.0	102.0	87.4	97.4	0.1	3.15
100	1	1	82.0	90.0	92.0	102.0	87.4	97.4	0.1	3.15

Installation Guidance

Point	Advice
1	EN/IEC 60079-10 EN/IEC 60079-14 National Electrical Code (NEC 500 – 505) Canadian Electrical Code (CSA C22.1)
2	Installation should only be carried out by a competent electrician, skilled in cable gland installation.
3	Comprehensive details of the compliance standards can be found on the product certificates which are available for download from our website.
4	NO INSTALLATION SHOULD BE CARRIED OUT UNDER LIVE CONDITIONS.
5	Threaded entries: the product can be installed directly into threaded entries. Threaded entries should comply with clause 5.3 of IEC/EN 60079-1 and have a lead-in chamfer to allow for full engagement of the threads. For Ex d applications a minimum of 5 fully engaged parallel threads is required. Metric threads are supplied with an o-ring and will maintain IP66 and IP68. Parallel entry threads will maintain an IP rating of IP64. A sealing washer should be used to maintain all IP ratings greater than IP64. Any thread sealant used should be non-hardening.
6	Clearance holes: these may be 0.1 to 0.7mm larger than the major diameter of the male thread. The product should be secured with a lock nut and the threads tightened to ensure the cable gland is secure. A sealing washer should be used to maintain IP ratings. A serrated washer should be used for additional installation protection.
7	To maintain the Ingress Protection rating of the product, the entry hole must be perpendicular to the surface of the enclosure. The surface should be sufficiently flat and rigid to make the IP joint. The surface must be clean and dry. It is the users/installers responsibility to ensure that the interface between the enclosure and cable gland is suitably sealed for the required application.
8	Whilst Peppers products with tapered threads, when installed into a threaded entry, have been tested to maintain IP66 without any additional sealant, due to the differing gauging tolerances associated with the use of tapered threads it is recommended to use a non-hardening thread sealant if an IP rating higher than IP64 is required.
9	Once installed do not dismantle except for routine inspection. An inspection should be conducted as per IEC/EN 60079-17. After inspection the gland should be re-assembled as instructed, ensuring the compression nut, mid cap and back nut are correctly tightened to ensure the cable is secure.
10	For Ex d applications, these glands should only be used with substantially round and compact cables with extruded bedding (i.e. effectively filled cables) that are compliant with EN/IEC 60079-14.
11	If required an anti-seize lubricant may be used to aid assembly and routine inspection. The lubricant should comply with the prevailing code of practice and care should be taken to ensure no lubricant comes into contact with the cable gland seals as this may impair performance.

Approvals and Certification

Approval	Certificate Number	Protection Concept / Type
ATEX (2014/34/EU)	BAS 01ATEX2271X	Ex II 1D 2G Ex d IIC Gb / Ex e IIC Gb / Ex ta IIIC Da
	Sira 09ATEX1221X	Ex II 3G Ex nR IIC Gc
IECEX	IECEX SIR 07.0099X	Ex d IIC Gb / Ex e IIC Gb / Ex ta IIIC Da
CSA - Canada	1356011	Ex d IIC / Ex e II / CL I Div 2 Gr ABCD / CL II Gr EFG / CL III Type 4X
CSA - US	2627370	Class II, Division 1, Groups EFG / Class III; Type 4X Class I Zone 1 AEx e IIC Gb / Class II, Zone 20 AEx ta IIIC Da IP66 IP68
INMETRO	NCC 13.2185 X	Ex d IIC Gb / Ex e IIC Gb / Ex ta IIIC Da / Ex nR IIC Gc
EAC	RU C-GB. Г506.B.00098	Ex d IICU / Ex e IIU / Ex nR IIU
UKRAINE	UA.TR.047.C.0408-13 & 2937	Ex d IIC X / Ex e II X
NEPSI	GYJ16.1402X	Ex d IIC / Ex e IIC
Korea	15GA4BO-0669X / 15GA4BO-0670X	Ex d IIC / Ex e IIC
CCoE / PESO	P365300/2 & P365300/14	Ex d IIC Gb (Zone 1) / Ex e IIC Gb (Zone 2) / Ex nR IIC Gc (Zone 2)
ABS	14-LD463991-1-PDA	Specified ABS Rules – See certificate
Lloyd's Register	10/00056(E1)	Ex d IIC Gb / Ex e IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
Russian Maritime	14.02755.315	Ex d IIC Gb / Ex e IIC Gb / Ex ta IIIC Da

Interpretation of Markings. Markings on the outside of this gland carry the following meanings:

Cable Gland Type & Size CR-a-b-R-ccc-ddd-nn

a =	Seal Type 1 = Neoprene (black) 2 = Neoprene with Continuity washer 3 = Silicone (white) 4 = Silicone with Continuity Washer	ccc =	Gland size
b =	Main component material B = brass S = stainless steel	ddd =	Entry thread type and size
R =	Optional reduced bore outer seal (red silicone)	nn =	Year of manufacture

Special Conditions for Safe Use

- These glands must not be used in enclosures where the temperature at the point of contact is outside the range of -35°C to +90°C using neoprene seals, or -60°C to +180°C using silicone seals.
- When the gland is used with increased safety and/or dust protected equipment, the entry thread shall be suitable sealed to maintain the ingress protection rating of the associated enclosure.
- If these cable glands only grip the cable sheath of the cable and do not clamp the cable armour or if they are used to terminate unarmoured, braided or screened cables, then they shall only be used for fixed installations, hence the cables shall be effectively clamped to prevent pulling or twisting.
- These glands, when installed in accordance with the manufacturers instructions and with an appropriate enclosure on which they are fixed, are capable of providing an ingress protection of IP66 and IP68 (50 metres - 7 days)
- Where glands without sealing rings are installed in protection by enclosure (Ex t) equipment for use in explosive dust atmospheres, they may only be fitted into enclosures offering a minimum of 5 full threads, in accordance with EN 60079-31:2009 clause 5.1.1.